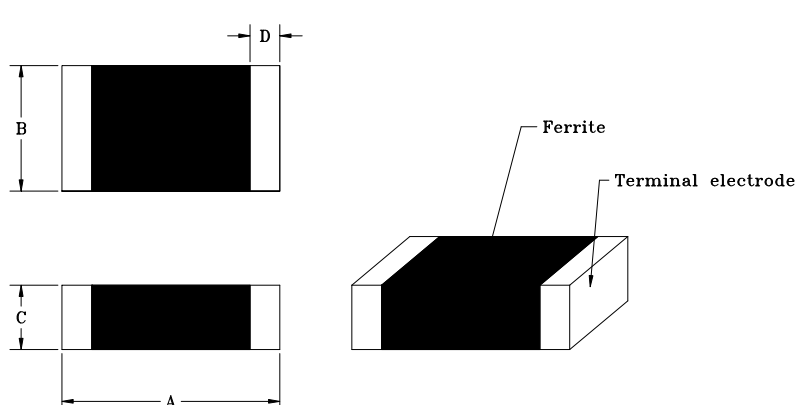


SPECIFICATION FOR APPROVAL

COMMODITY	CHIP BEAD	SPEC NO.	SP-0100809001
ITEM	JCB 160808-102/0.8 Green	版本：A	表單編號：TRR-002

(1) DIMENSION: (UNIT: mm)		DIM.	TOL.
	A	1.6	±0.2
	B	0.8	±0.2
	C	0.8	±0.2
	D	0.3	±0.2
	E		
	F		
	G		
	H		
	I		
	J		

(2) ELECTRICAL CHARACTERISTIC	TEST INSTRUMENTS.																					
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%;">IMPEDANCE</td> <td style="width: 20%; text-align: center;">1000 ± 25%</td> <td style="width: 10%; text-align: center;">Ω</td> </tr> <tr> <td>TEST FREQUENCY</td> <td style="text-align: center;">100</td> <td style="text-align: center;">MHz</td> </tr> <tr> <td>RDC</td> <td style="text-align: center;">0.25 (max)</td> <td style="text-align: center;">Ω</td> </tr> <tr> <td>IDC</td> <td style="text-align: center;">800 (max)</td> <td style="text-align: center;">mA</td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </table>	IMPEDANCE	1000 ± 25%	Ω	TEST FREQUENCY	100	MHz	RDC	0.25 (max)	Ω	IDC	800 (max)	mA										<input checked="" type="checkbox"/> AGILENT 4294A Precision Impedance Analyzer. <input type="checkbox"/> AGILENT 4285A Precision L.C.R. Meter. <input type="checkbox"/> HP-4286A RF L.C.R. Meter. <input checked="" type="checkbox"/> ZENTECH 3302 Automatic Components Analyzer. <input type="checkbox"/> ZENTECH 101 L.C.R. Meter. <input type="checkbox"/> WAYNE KERR 6420 Precision Impedance Analyzer. <input checked="" type="checkbox"/> ZENTECH 1320 BIAS CURRENT. <input checked="" type="checkbox"/> ZENTECH 502AC Resistance Merter. <input type="checkbox"/> ADEX AX-1155B DC Low Ohm Meter.
IMPEDANCE	1000 ± 25%	Ω																				
TEST FREQUENCY	100	MHz																				
RDC	0.25 (max)	Ω																				
IDC	800 (max)	mA																				


REMARK :

PURCHASER CONFIRMED	APPROVED	CHECKED	DRAWN
			

TEST REPORT

COMMODITY : CHIP BEAD	SPEC NO : SP-0100809001
Type : JCB 160808-102/0.8	版本 : A 表單編號 : TRR-004

Typical Impedance v.s. Frequency Curve

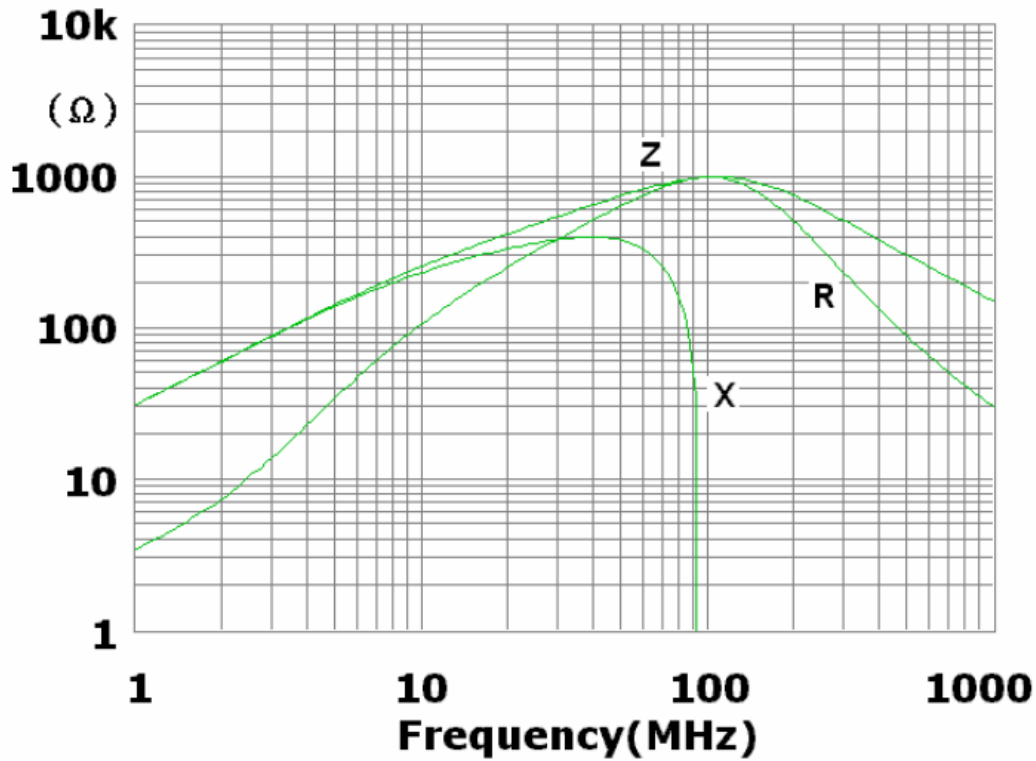

Test Instrument :

HP-4286A RF L.C.R. Meter.

Testing Condition :

Temperature : 25 to 28°C

Humidity : 60 to 70 % RH

Check by :



Test by :



JANTEK ELECTRONICS CO.,LTD

TEL : 886-2-2689-4971 FAX : 886-2-2689-4260

E-mail : jantek@jantek-elec.com.tw

Web-Site : www.jantek-elec.com.tw